


**OCESD#1**  
Fire Alarm Process  
Flow Chart

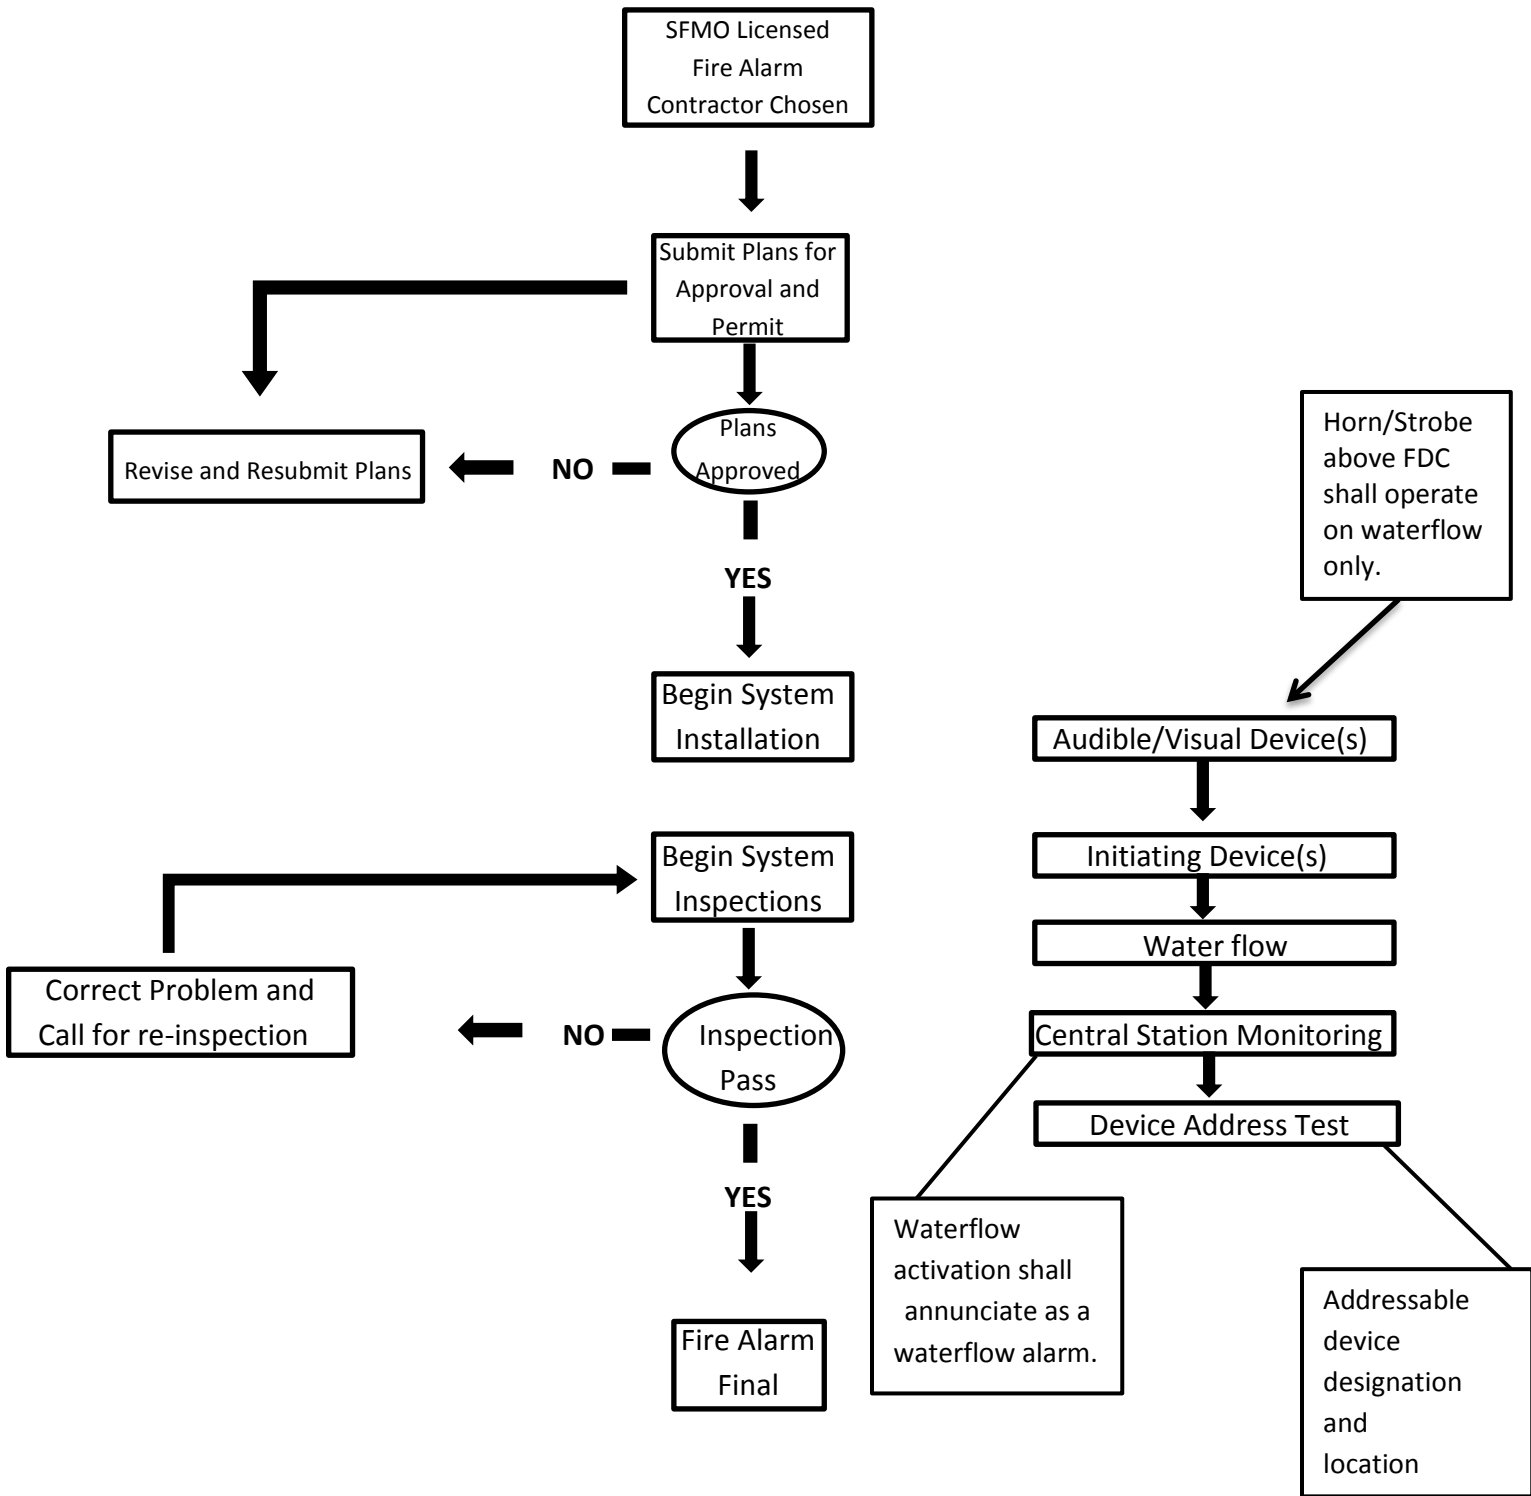

**NOTE:**  
The CSM shall differentiate between types of alarms. "General Alarm" is not permitted.  
(Waterflow alarm, smoke detector, pull station, etc...)